



Product Advantage - Lok



FL No.	9610.2
---------------	---------------

Material	Finish
	Galvalume
	Painted

Gauge (minimum)	26
------------------------	-----------

Deck Description	Plywood
New construction	19/32"
Existing construction	15/32"

Deck Attachment	Spacing
Perimeter Screws: #8 - 2" wood screws	6" O.C.
Field Screws: #8 - 2" wood screws	12" O.C.

Underlayment	30# Felt
---------------------	-----------------

Roof Slope Ranges	
Slope: 2/12 and greater	Yes

Panel Fasteners	Spacing
Pancake Screws: #10-12 x 1" long	See Tables
SDS Screws: #9 x 1 1/2" long	See Tables
Rivets: 1/8" stainless steel	See Tables

Fastener Spacing (along panel length, inches)

Wind Z Speed mph	one No. Roof Hip Location	Roof Slope			
		Gable Roof			Roof
		.5 to <1.5/12	1.5 to <6/12	6 to 12/12	1.5 to 5.5/12
100	1 Field	8	8	8	8
	2 Edge	8	8	8	8
	3 Corner	8	8	8	8
110	1 Field	8	8	8	8
	2 Edge	8	8	8	8
	3 Corner	8	8	8	8
120	1 Field	8	8	8	8
	2 Edge	8	8	8	8
	3 Corner	N/A	8	8	8
130	1 Field	8	8	8	8
	2 Edge	8	8	8	8
	3 Corner	N/A	N/A	8	8
140	1 Field	8	8	8	8
	2 Edge	8	8	8	8
	3 Corner	N/A	N/A	8	8

Fastener Spacing* (across panel width)

Panel Ends (eave, valley, hip and ridge): 5" o.c.	Location
Place fasteners 2" from panel end	Flat and Tab
Between Panel Ends (Intermediates)	Tab Only

*Fastener spacing based on testing

Notes:


1. Read all Notes before purchasing material and check compliance of the product with local building code requirements.
2. The Fastener Spacing Table below is based on a mean roof height of up to 25' for Exposure C. For roof eave heights over 25' and other exposures contact Union Corrugating Company.
3. Installation must be in complete compliance with the materials and related specifications listed on this page, Advantage - Lok Installation drawings, and the Florida Building Code RAS No. 133.
4. See Advantage - Lok installation drawings for additional approved trim details and applications.
5. Refer to Florida Building Code RAS No. 133 "Standard Procedures for Installation of Metal Roof Systems".
6. For applications not in compliance with this product approval as listed contact Union Corrugating Company for other options.
7. This application and installation method is for use in HVHZ areas governed by Miami Dade Product Approval. See the Union Corrugating Miami Dade Approved Product use guide for these areas.
8. If the roof has both Gables and Hips use the Gable Roof Fastener Spacing Table.
9. For Hip Roof slopes greater than 5.5/12 use Gable Roof Table, 6 to 12/12 column.
10. Guide is subject to change without notice.

Calculate Zone width (dimension "a"):


$a = \text{LHD} \times 10\%$

Note: "a" must be a minimum of 3'.

Gable Roof Zones (dashed areas)

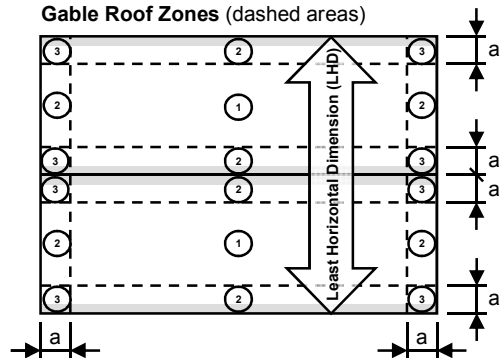

Hip Roof Zones (dashed areas)

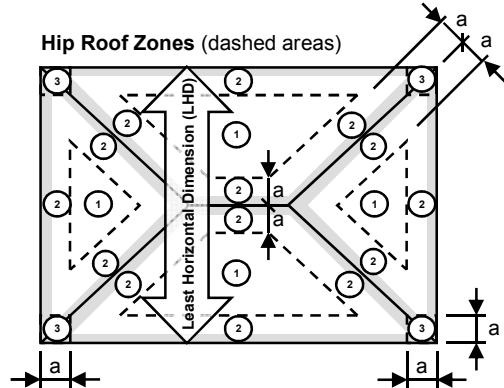

Gray highlighted lines indicate the location of panel end fastening at the eave, hip, valley (not shown), and ridge.



**BUILDING CODE COMPLIANCE OFFICE (BCCO)
PRODUCT CONTROL DIVISION**

**MIAMI-DADE COUNTY, FLORIDA
METRO-DADE FLAGLER BUILDING
140 WEST FLAGLER STREET, SUITE 1603
MIAMI, FLORIDA 33130-1563
(305) 375-2901 FAX (305) 375-2908**

NOTICE OF ACCEPTANCE (NOA)

**Union Corrugating Company
P.O. Box 229
Fayetteville, NC 28302**

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed by Miami-Dade County Product Control Division and accepted by the Board of Rules and Appeals (BORA) to be used in Miami Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Division (In Miami Dade County) and/or the AHJ (in areas other than Miami Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. BORA reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Division that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: Advantage-Lok® Metal Roof Panel

LABELING: Each panel shall bear a permanent label with the manufacturer's name or logo, city, state and the following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This renews NOA # 05-0919.06 and consists of pages 1 through 4.
The submitted documentation was reviewed by Alex Tigera.



**NOA No.: 08-0402.10
Expiration Date: 07/10/13
Approval Date: 06/05/08
Page 1 of 4**

ROOFING SYSTEM APPROVAL:

Category: Roofing
Sub-Category: Metal, Panels(Non-Structural)
Material: Steel
Deck Type: Wood
Maximum Design Pressure See Table A herein

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

<u>Product</u>	<u>Dimensions</u>	<u>Test Specifications</u>	<u>Product Description</u>
Advantage-Lok Standing Seam	l = various w = 16" min. 0.0190" thick	TAS 110 & TAS 125	Metal Roof panel coated with various approved coatings of Ceram-A-Star® 900.
Trim Pieces	l = varies w = varies min. 0.0190" thick	TAS 110	Standard flashing and trim pieces. Manufactured for each panel width.

EVIDENCE SUBMITTED

<u>Test Agency</u>	<u>Test Identifier</u>	<u>Test Name/Report</u>	<u>Date</u>
Hurricane Test Laboratories, Inc.	0293-0612-05	TAS 125	06/29/05
PRI Asphalt Technologies, Inc.	UCC-003-02-01	TAS 100	12/18/02
W.W. Schaefer Engineering & Consulting, P.A.	N/A	Fastener Calculations	02/17/03



APPROVED ASSEMBLIES

SYSTEM A-1S: "Advantage-Lok Standing Seam" 26 ga. Metal Panels

Deck Type: Wood, Non-insulated

Deck Description: $1\frac{9}{32}$ " or greater plywood or wood plank.

Slope Range: 2":12" or greater

Maximum Uplift Pressure: See Table A below

Deck Attachment: In accordance with applicable Building Code, but in no case shall it be less than #8 x 2" wood screws spaced 6" o.c around the perimeter and 12" o.c. in the field. In reroofing, where the deck is less than $1\frac{9}{32}$ " thick (Minimum $1\frac{5}{32}$ ") The above attachment method must be in addition to existing attachment.

Underlayment: Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and 12 gauge 1 $\frac{1}{4}$ " annular ring-shank nails, spaced 6" o.c. at all laps and two staggered rows 12" o.c. in the field of the roll. Or, any approved underlayment having a current NOA.

Valleys: Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with Union Corrugating Company's current published installation instructions.

Fire Barrier Board: Any approved fire barrier having a current NOA. Or for class A or B fire rating, install minimum $\frac{1}{4}$ " thick Georgia Pacific "Dens Deck" (with current NOA) or minimum 4mm thick of Tritex, RockRoof (with current NOA) or $\frac{5}{8}$ " water resistant type X gypsum sheathing with treated core and facer.

Metal Panels and Accessories:

Install the " Advantage-Lok Panels " and accessories in compliance with Union Corrugating Company's current, published installation instructions and details. Flashing, penetrations, valley construction and other details shall be constructed in compliance with the minimum requirements provided in Roofing Application Standards RAS 133.

1. At the eave, rake, and ridge, fasteners shall be located not more than 2" away from the panel end.
2. Panels shall be fastened to substrate at the male end with one corrosion resistant #10 screw of sufficient length (but not less than 1") to penetrate through the sheathing a minimum of $\frac{3}{16}$ ", at a spacing not exceed 8" o.c. parallel to the slope of the roof. (See detail herein)
3. The panels male/female overlapping seam shall be riveted with a 1/8" stainless steel rivet at a maximum spacing noted in **Table A** below. (See detail herein)


TABLE A		
Maximum Design Pressure		
	Field	Perimeter and Corner¹
Maximum Design Pressure	-76.8 psf	-84.30 psf
Maximum RIVET Spacing	32" o.c.	24" o.c.
1. Extrapolation shall not be allowed		



SYSTEM LIMITATIONS

1. Neither rational analysis, nor extrapolation shall be permitted for the maximum design pressures listed in the "Perimeter and Corner" roof areas as noted in Table "A" herein. .
2. Panel shall be roll formed in continuous lengths from eave to ridge. Maximum lengths shall be described in the Roofing Application Protocol RAS 133.
3. All panels shall be permanently labeled with the manufacturer's name and/or logo, and the following statement: "Miami-Dade County Product Control Approved."
4. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 9B-72 of the Florida Administrative Code.

PROFILE DRAWINGS

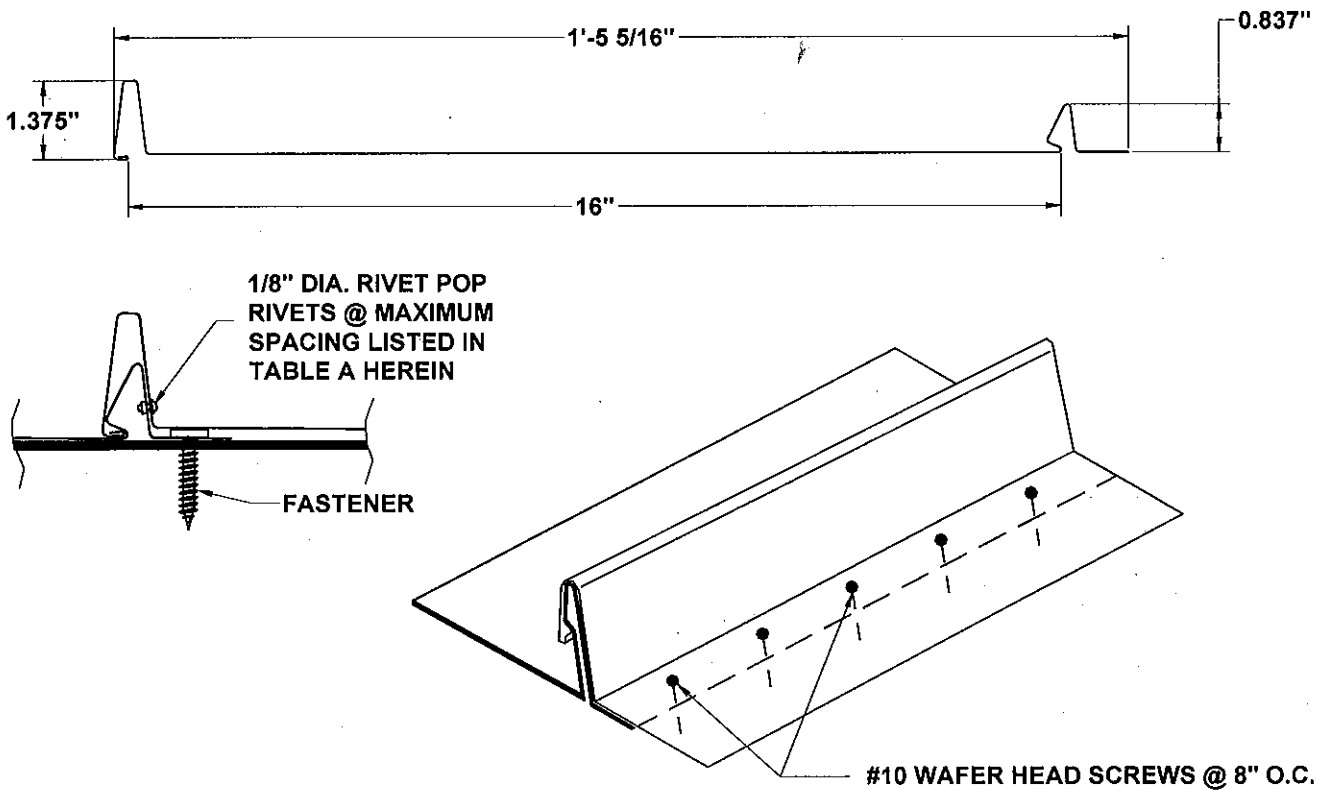

"ADVANTAGE-LOK®" METAL ROOF PANELS

END OF THIS ACCEPTANCE



NOA No.: 08-0402.10
Expiration Date: 07/10/13
Approval Date: 06/05/08
Page 4 of 4

